


Typical Water Product Quality

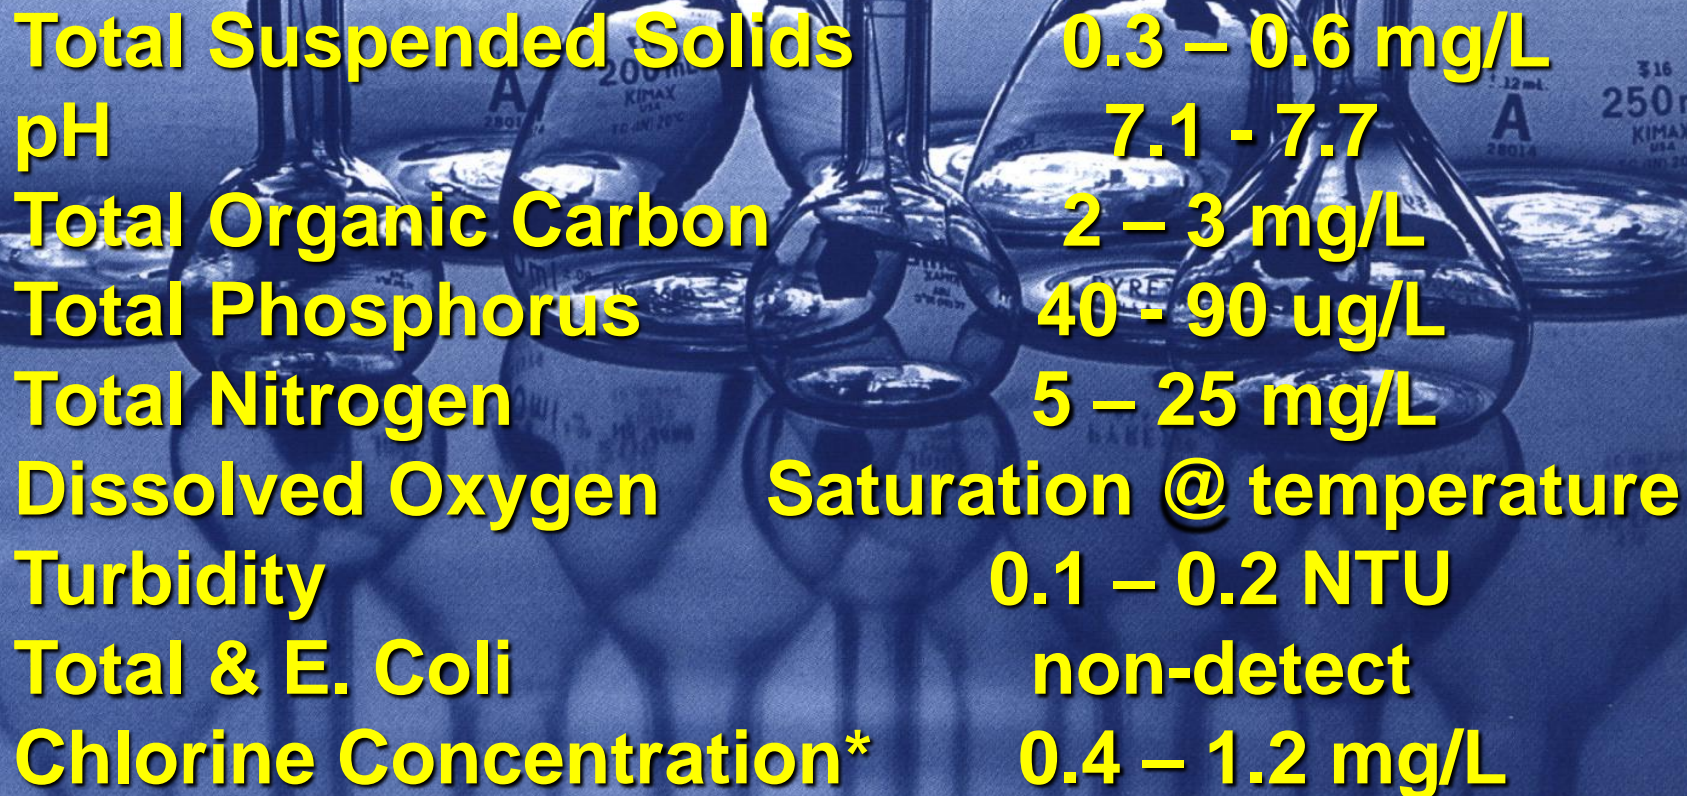

Total Suspended Solids	0.3 – 0.6 mg/L
pH	7.1 - 7.7
Total Organic Carbon	2 – 3 mg/L
Total Phosphorus	40 - 90 ug/L
Total Nitrogen	5 – 25 mg/L
Dissolved Oxygen	Saturation @ temperature
Turbidity	0.1 – 0.2 NTU
Total & E. Coli	non-detect
Chlorine Concentration*	0.4 – 1.2 mg/L

***de-chlorinated to non-detect after disinfection**